

Table of Contents

1	Purpose.....	1
2	Scope	1
3	Referenced Codes and Standards	2
4	Terms and Definitions	2
4.1	Capacity Response Spectrum (CRS)	2
4.2	Critical Infrastructure	2
4.3	Damping	2
4.4	Design Earthquake.....	3
4.5	Designated Seismic System	3
4.6	Electrical Equipment	3
4.7	Enclosure Force-Resisting System (EFRS)	3
4.8	Equipment Importance Factor.....	3
4.9	Functional Requirements	3
4.10	Nonstructural Component	3
4.11	Parent Equipment, Flexible, Highly	3
4.12	Parent Equipment, Flexible, Moderately	3
4.13	Performance Requirements	4
4.14	Phase Incoherent Accelerograms	4
4.15	Qualified Person.....	4
4.16	Required Response Spectrum (RRS).....	4
4.17	Seismic (Earthquake) Demand	4
4.18	Structural Integrity	4
4.19	Subcomponent Amplification Factor, $A_{FACTOR} > 1.0$	4
4.20	Subcomponent Supports and Attachments	4
4.21	Target Test Level	4
4.22	Test Response Spectrum (TRS).....	5
4.23	Type Testing Rationalization.....	5
4.24	Zero Period Acceleration (ZPA)	5
5	Symbols	5
6	Subcomponent Test Unit and Pre-Test Information	6
6.1	Manufacturer and/or Supplier Information	6
6.2	Subcomponent Functional Unit Description.....	6
6.2.1	Electrical Ratings.....	6
6.2.2	Mechanical Characteristics	7
6.2.3	Subcomponent Supports and Attachments	7

6.3	Subcomponent Testing Requirements.....	7
6.3.1	Target Test Levels.....	7
6.3.2	Continuous Monitoring Instrumentation	9
6.3.3	Performance Criteria for Seismic Testing	10
6.4	Subcomponent Test Plan.....	11
6.5	Representative Product Sampling	11
7	Subcomponent Certification Test Procedure	11
7.1	Pre-Test Inspection and Test Unit Setup	12
7.2	Pre-Test Functional Compliance Verification.....	12
7.3	Seismic Simulation Test Setup	12
7.3.1	Triaxial, Biaxial, and Uniaxial Testing Requirements.....	13
7.3.2	Resonant Frequency Search	13
7.4	Seismic Simulation Test.....	13
7.4.1	Required Response Spectra (RRS)	13
7.4.2	Derivation of Test Input Motion	14
7.4.3	Zero Period Acceleration (ZPA) Amplitude Intensity.....	14
7.4.4	Shake-Table Test Run	15
7.4.5	Test Response Spectrum (TRS) Analysis	15
7.4.6	Subcomponent Test Unit Capacity Response Spectra (CRS).....	15
7.5	Post-Test Inspection	16
7.6	Post-Test Functional Compliance Verification	17
7.7	Seismic Certification Test Series	17
8	Test Laboratory Reports of Test	17
8.1	Test Laboratory Information	17
8.2	Test Equipment and Quality Assurance.....	18
8.3	Test Unit, Test Levels, and Acceptance Criteria.....	18
8.4	Test Results Reporting.....	18
Appendix A. Subcomponent Supports and Attachment Mounting		19

Figures

Figure 1 Electrical Equipment Nomenclature Distinguishing Parent and Child Test Units	1
Figure 2 Subcomponent Demand Spectrum Used for Subcomponent Functional Unit Testing; Shape Profiles Based on ICC-ES AC156.....	8
Figure 3 Example Shake-Table Accelerogram Showing Input Signal Build-Hold-Decay Envelope	14

1 Purpose

The purpose of this test standard is to establish minimum requirements for the seismic certification of electrical and medical imaging equipment subcomponents by shake-table testing subcomponents independent of the parent equipment they are contained in. This test standard is compatible with the special certification requirements for designated seismic systems contained in the 2018, 2015, and 2012 International Building Code® (IBC) nonstructural seismic provisions.

The reason for the development of this standard is to provide detailed procedures for seismic certification by testing nonstructural electrical and medical imaging equipment subcomponents independent of the parent equipment to augment testing subcomponents at the equipment level. There are three sets of test criteria: (1) subcomponent test unit and pre-test information, (2) subcomponent certification test procedure, and (3) test laboratory reports of test. Testing done in accordance with these criteria is intended to enhance certification data for the seismic certification of electrical and medical imaging nonstructural components permanently attached to structures, as specified in the IBC model code and ASCE/SEI 7 design standard.

2 Scope

These test criteria are applicable for shake-table testing of electrical and medical imaging equipment subcomponent functional units per Figure 1 nomenclature. The term “subcomponent” is used herein to describe various types of equipment functionality resulting from the assemblage of equipment devices (i.e., subcomponents) and subassemblies that deliver specific electrical distribution, control, electromagnetic, and imaging functions. Subcomponent functional unit testing (i.e., child testing) per these criteria is conducted to augment equipment testing (i.e., parent testing) per ICC-ES AC156 test protocol.

Subcomponent testing assumes an equipment importance factor, I_p , greater than one, which requires post-test subcomponent functionality validation for designated seismic systems servicing critical infrastructure. Additionally, subcomponent testing per these criteria assumes that seismic qualification rationalization has been conducted to identify the subcomponents requiring testing for a given product line. This test standard provides procedures and criteria for testing subcomponents and does not provide selection criteria for type testing rationalization for electrical equipment. This test standard is not applicable for use on mechanical or architectural nonstructural components.

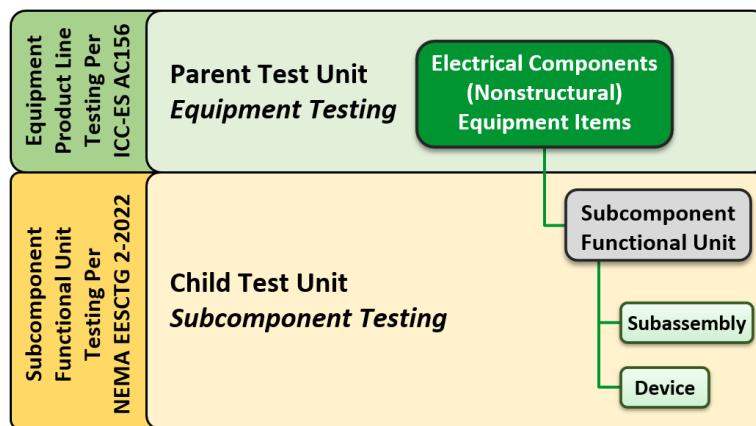


Figure 1
Electrical Equipment Nomenclature
Distinguishing Parent and Child Test Units